



PO Box 56007  
Boston, MA 022057

Town of Watertown  
246 Warren Street  
Watertown MA 02472

Account Number  
4000-408-8692

PLEASE PAY \$11,840.00  Due BY: 2/2/2021
--

EVERSOURCE ENERGY

Thank you for your new work request for electric service. To process your request a customer cost of \$11,840.00 is required (payable to Eversource Electric Company).

For more information, please contact the New Customer Connections Department 1-888-633-3979 and reference WO# 02405525. Thank you.

**Service Provided to**

246 Warren Street, Watertown MA 02472

Account Summary	
Previous Bill	0.00
Payments - Thank you	0.00
<b>Amount Due</b>	<b>\$11,840.00</b>



**INVOICE**

**Customer**

<b>Name</b>	Town of Watertown		
<b>Address</b>	246 Warren Street		
<b>City</b>	Watertown	<b>State</b> MA	<b>ZIP</b> 02472
<b>Phone</b>	617-924-0439		

**Work Order Info**

<b>WO#</b>	2405525
<b>Service Address</b>	246 Warren Street
<b>Service Town</b>	Watertown
<b>Eversource Rep</b>	Kim Khounesombat

Eversource Work	

Outside Services	

Labor	2,993
Material	2,930
Outside Services	5,917
Vehicles	
Revenue Credit	
<i>Subtotal</i>	
Carrying Charge (15.4%)	
Private Property Charges	
Design Deposit	
<b>TOTAL</b>	<b>\$11,840</b>

\*\* Tax Reform Act of 1986

That a utility report an item of gross income the value of any property, including money that it receives to provide, or encourage the provision of services to or for the benefit of the person transferring the property. A utility is considered as having recieved property to encourage the provision of services if the receipt of the property is a prerequisite to the provision of the services if the receipt of the property results in the provision of services earlier than would have been the case had the property not been received or if the receipt of the property otherwise causes the transferor to be favored in any way

The person transferring the property will be considered as having benefited if he is the person who will receive the services, as owner of the property that will receive the services, a former owner of the property that will receive the services, or if he derives any benefit from the property that will receive the services. Accordingly, a builder who transfers property to the utility in order to obtain services for a house that he was paid to build will be considered as having benefited from the provision of the services. This will be the case despite the fact that the builder may never have had ownership interest in the property and may make the transfer to the utility after the house has been completed and accepted

**Please mail your payment to:**  
**Eversource Energy**  
**1165 Massachusetts Avenue Attn:**  
**Dorchester, MA 02125**

Cunniff Elementary School  
New School Building

W.O.# PP02405525  
246 Warren St, Watertown  
Cunniff Elementary School (New Bldg)  
2500Amp, 277/480V service  
Circuit 467-H1  
Pole page  
Page 1 of 4  
Aruna Sikharam  
Not Drawn to scale  
10/24/20


Legend

- Existing pole
- Existing riser pole
- New pole

Verizon to replace the following 5 poles on Warren St

- 1) P156/24 45' W/50' CL1 JO TELCO 1923
- 2) P156/26 40' W45' CL2 JO TELCO 1923
- 3) P156/27 40' W/45' CL2 JO TELCO 1923
- 4) P156/28 40' W/50' CL1 JO TELCO 1923
- 5) P156/29 40' W45' CL2 JO TELCO 1923


Eversource to set a 45' CL2 pole, P156/28-1X on private property. 85'+/- from P156/28  
Note :P156/28-1X to become riser pole.

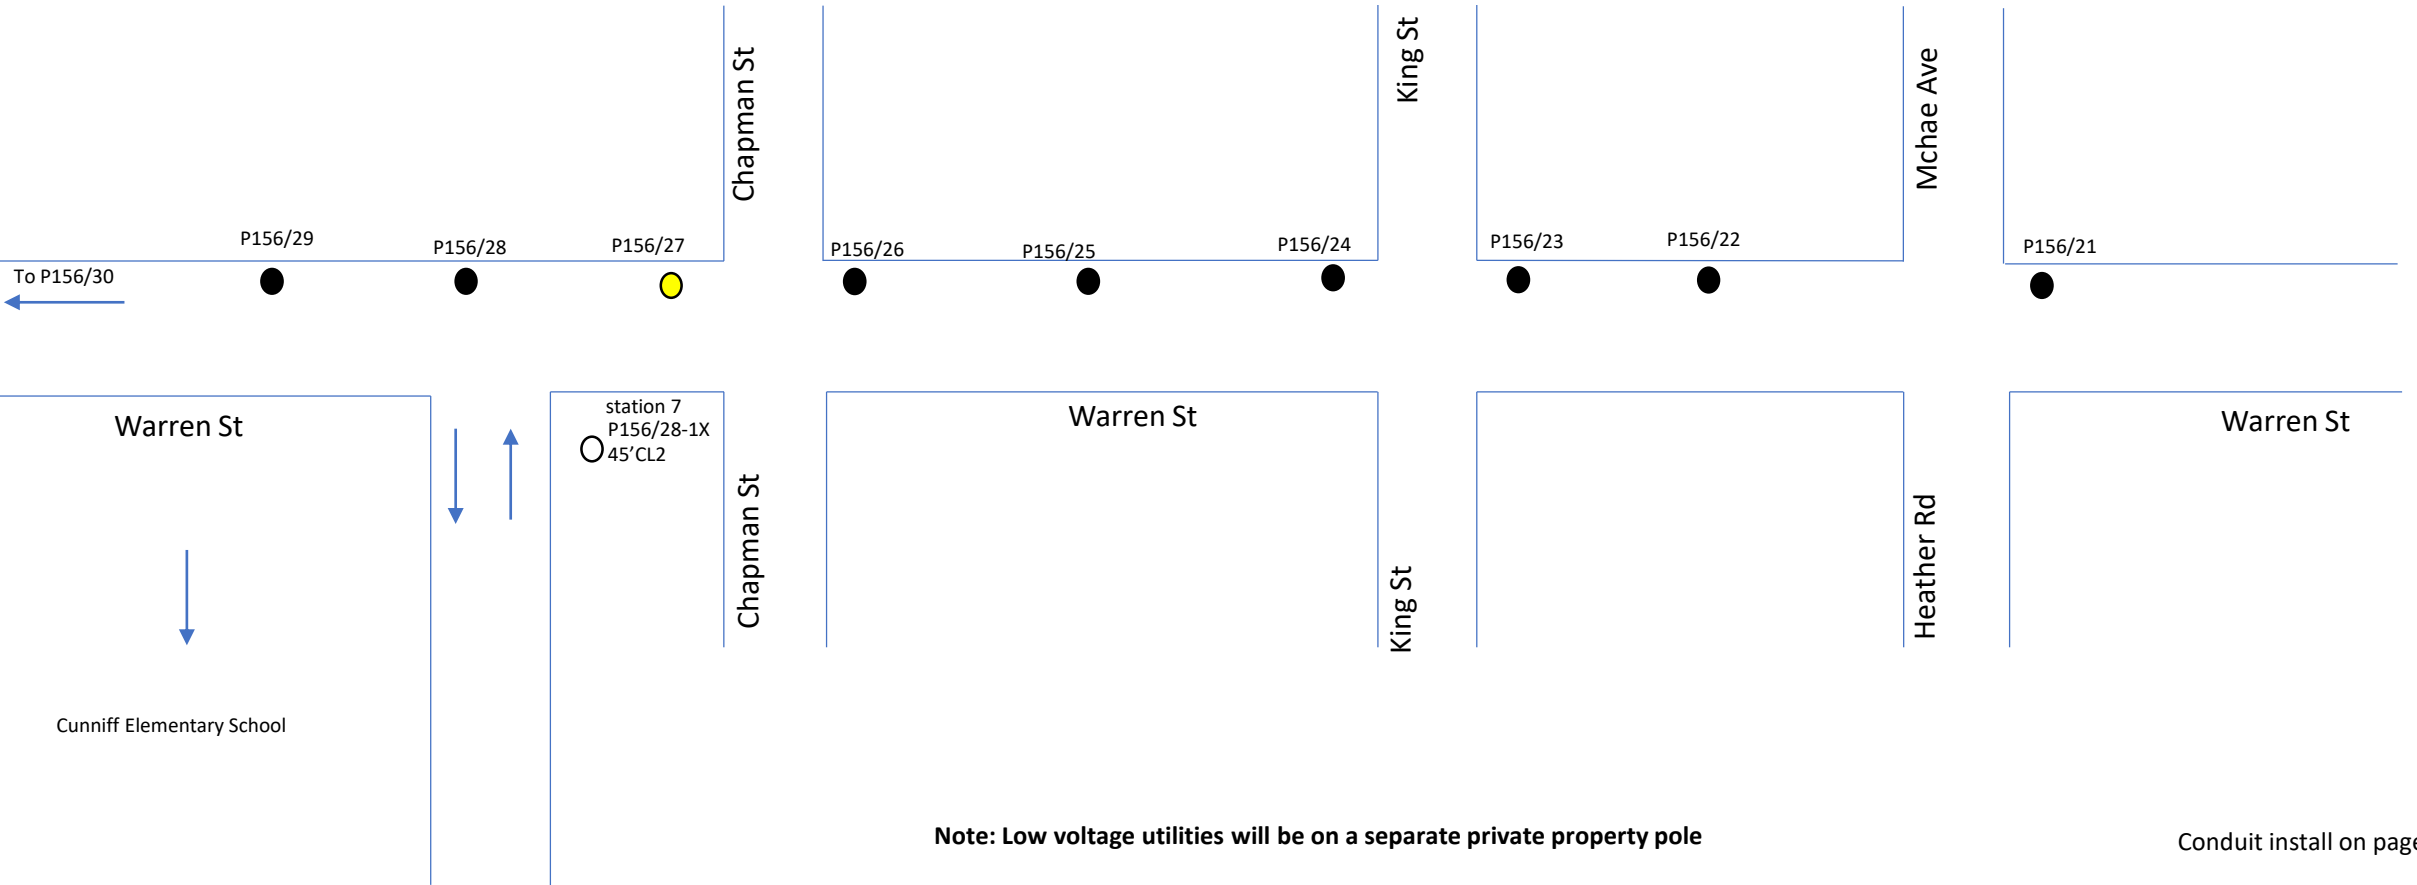



**Note: Low voltage utilities will be on a separate private property pole**

Conduit install on page 2

Legend



W.O.# PP02405525  
 246 Warren St, Watertown  
 Cunniff Elementary School (New Bldg)  
 2500Amp, 277/480V service  
 Circuit 467-H1  
 Conduit page  
 Page 2 of 4  
 Aruna Sikharam  
 Not Drawn to scale  
 10/24/20

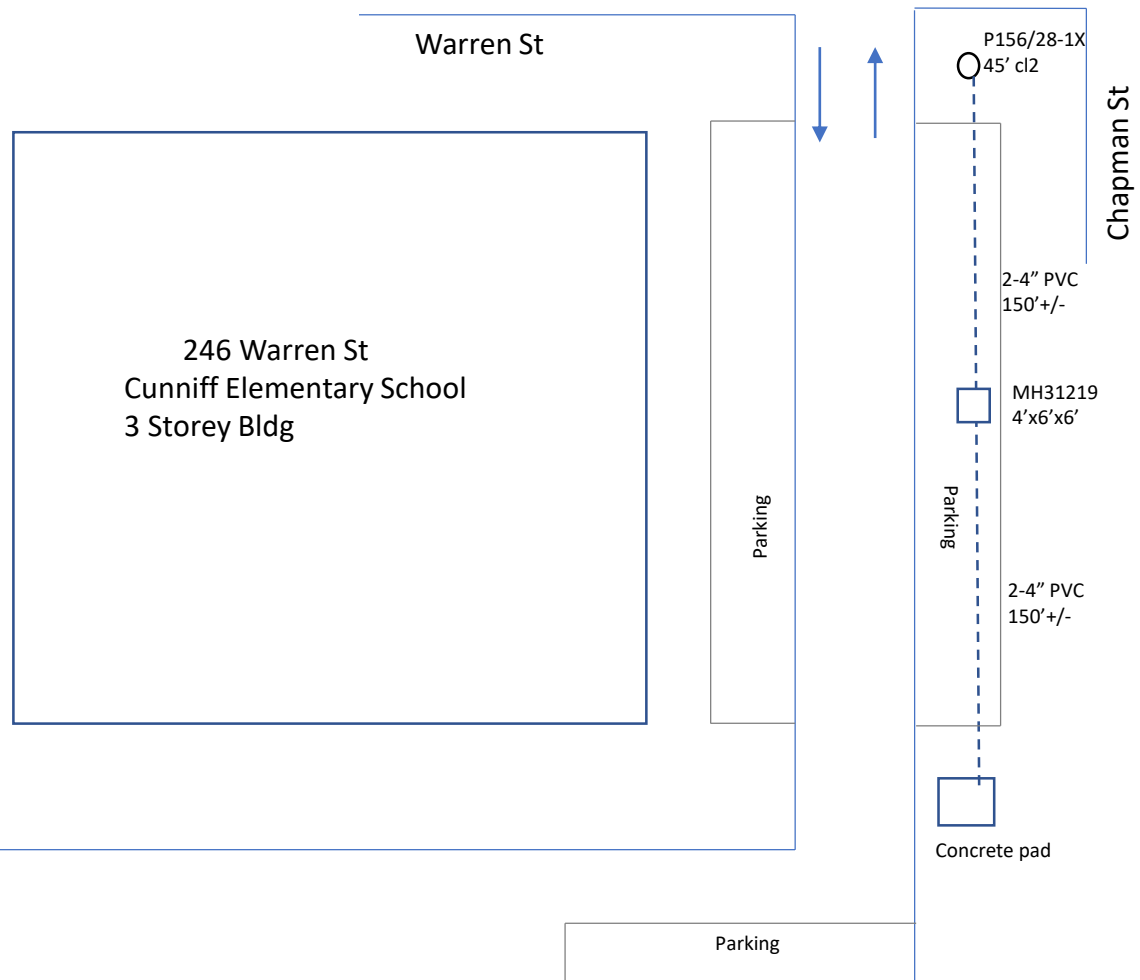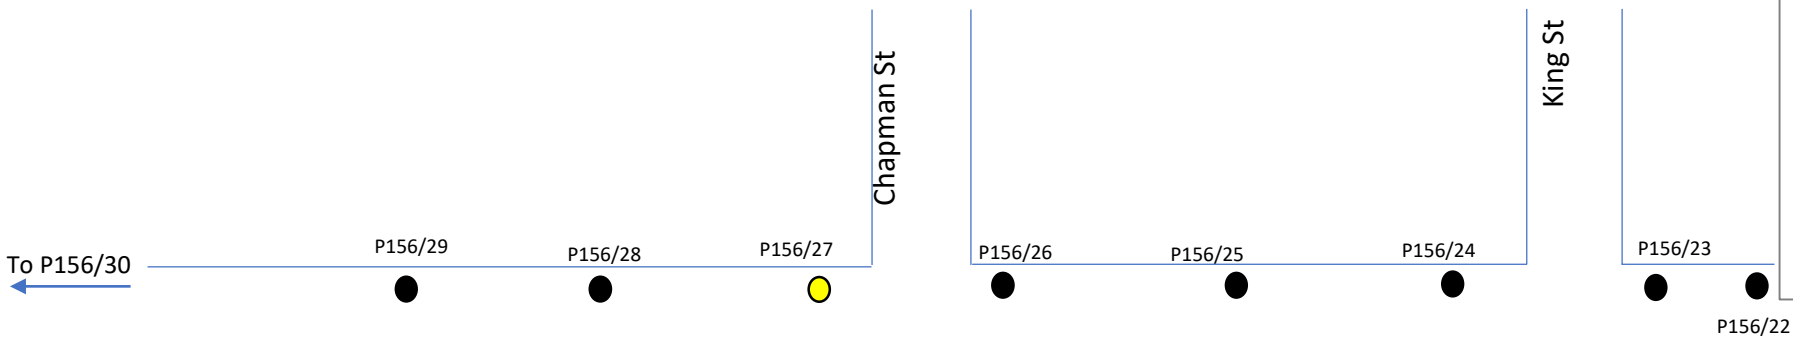


- Customer to do the following:
- 1) Install a concrete foundation per Eversource specs
  - 2) Install a 4'x6'x6' manhole, MH31219 as indicated.
  - 3) Install 2-4" PVC conduits encased in concrete from private property pole, P156/28-1X to the concrete foundation via MH31219. 2 sections. L = 300'+/-

Legend

○ New pole  
 - · - · - New OH wire  
 - - - - New cable

W.O.# PP02405525  
 246 Warren St, Watertown  
 Cunniff Elementary School (New Bldg)  
 2500Amp, 277/480V service  
 Circuit 467-H1  
 Cable page  
 Page 3 of 4  
 Aruna Sikharam  
 Not Drawn to scale  
 10/24/20

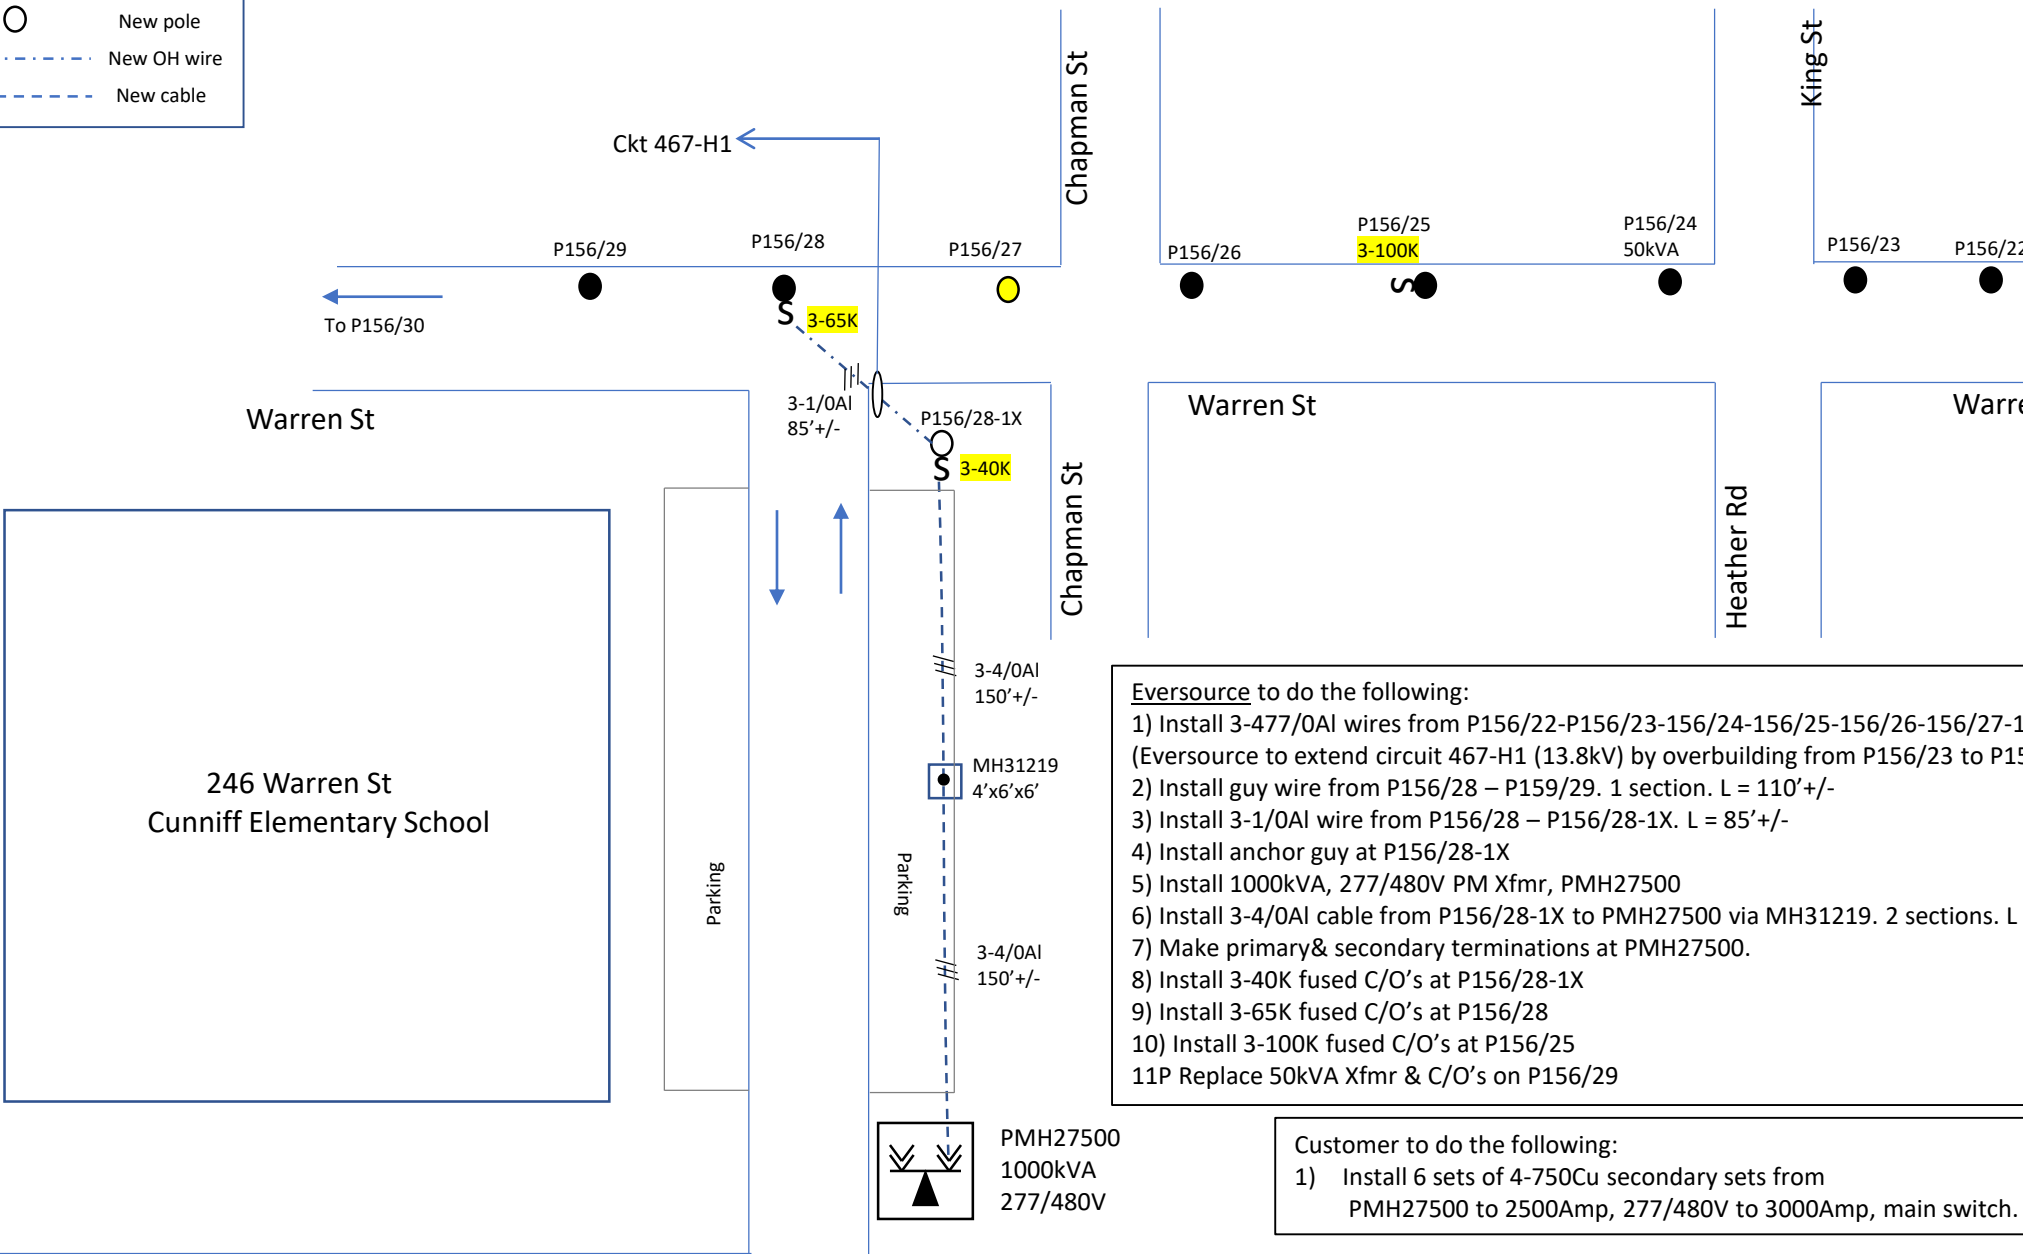

**Eversource to do the following:**

- 1) Install 3-477/0Al wires from P156/22-P156/23-156/24-156/25-156/26-156/27-156/28. 7 sections. 698'+/- (Eversource to extend circuit 467-H1 (13.8kV) by overbuilding from P156/23 to P156/28)
- 2) Install guy wire from P156/28 – P159/29. 1 section. L = 110'+/-
- 3) Install 3-1/0Al wire from P156/28 – P156/28-1X. L = 85'+/-
- 4) Install anchor guy at P156/28-1X
- 5) Install 1000kVA, 277/480V PM Xfmr, PMH27500
- 6) Install 3-4/0Al cable from P156/28-1X to PMH27500 via MH31219. 2 sections. L = 300'+/-
- 7) Make primary & secondary terminations at PMH27500.
- 8) Install 3-40K fused C/O's at P156/28-1X
- 9) Install 3-65K fused C/O's at P156/28
- 10) Install 3-100K fused C/O's at P156/25
- 11P Replace 50kVA Xfmr & C/O's on P156/29

**Customer to do the following:**

- 1) Install 6 sets of 4-750Cu secondary sets from PMH27500 to 2500Amp, 277/480V to 3000Amp, main switch. L = 170' +/-

**Note: Metering to be at the padmount xfmr**

246 Warren St  
 Cunniff Elementary School

Parking

Parking

Parking

Eversource to set a 45' CL2 pole, P156/28-1X on private property. 85'+/- from P156/28  
Note :P156/28-1X to become riser pole.

INSTALL 3-477 AL PRIMARY 13.8 KV OVERBUILD  
FROM P 156/22 TO 156/29  
7 SECTIONS TL= 698'

**VERIZON TO REPLACE POLES**


156/24 45' W/ 50' CL1 JO TELCO 1923  
156/26 40' W/ 45' CL2 JO TELCO 1923  
156/27 40' W/ 45' CL2 JO TELCO 1923  
156/28 40' W/ 50' CL1 JO TELCO 1923  
156/29 40' W/ 45' CL2 JO TELCO 1923

INSTALL 3-1/O AL PRIMARY & 1-1/O AL NEUTRAL  
FROM P 156/28 TO 156/28-1X  
1 SECTION TL= 85'

P 156/25 INSTALL 3-100K FUSES  
P 156/28 INSTALL 3-65K FUSES  
TOWARDS 156/28-1X  
P 156/28-1X INSTALL 3-40K FUSES & 3 L/AS  
TOWARDS PMH27500

P 156/29  
REPLACE 100 KVA D/R XFRMR & CUTOUT

P 156/23 LOWER 4K CONSTRUCTION  
P 156/25 LOWER 4KV CONSTRUCTION

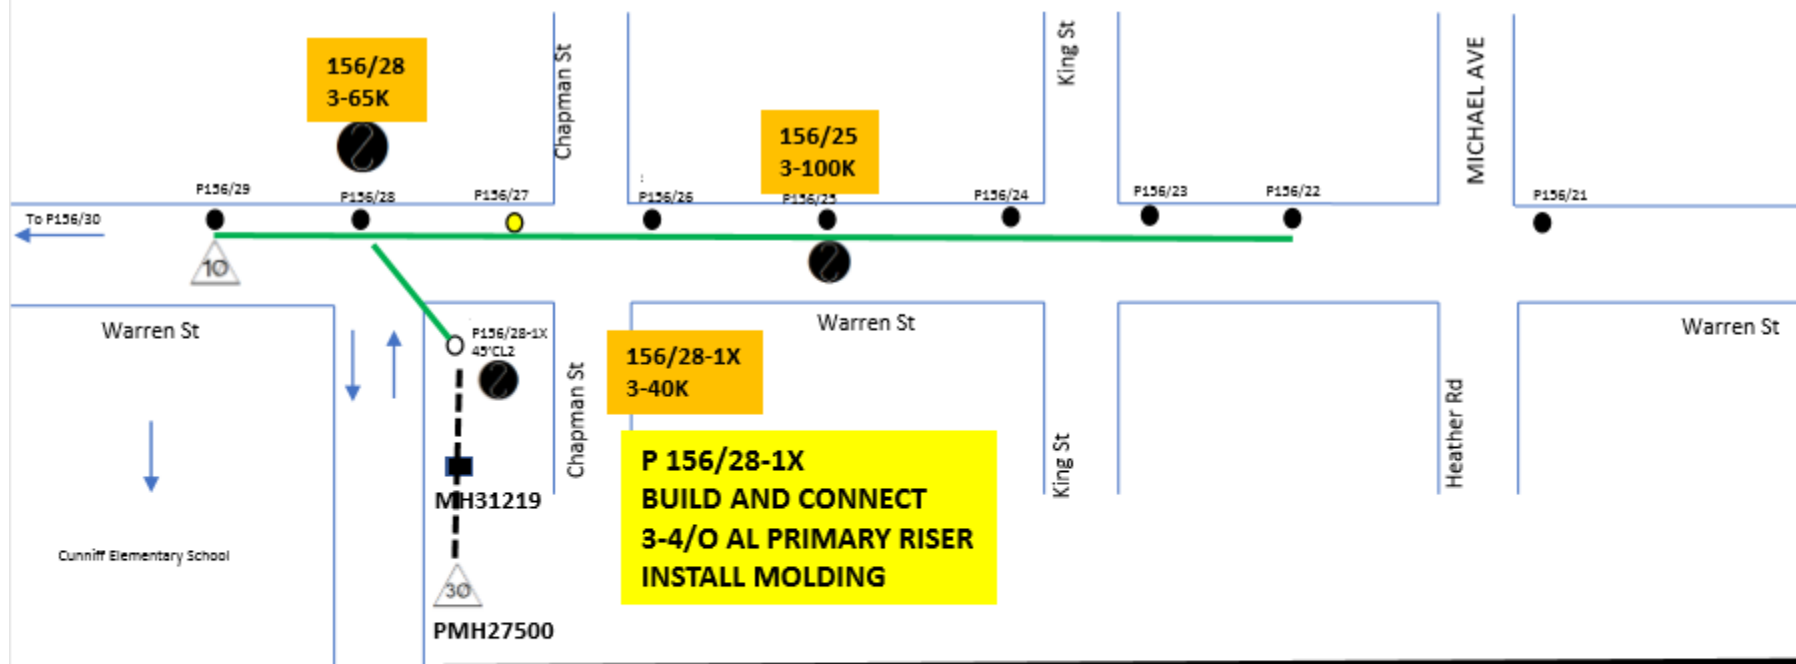

W.O. PP02405525  
CUNIFF SCHOOL  
246 WARREN ST

WATERTOWN  
CIR 467-H1

OH SKETCH  
4 of 4

CHRIS BROLIN ECSD  
11/6/20